


NOTES:


1. THE CELLS SHALL BE ANCHORED SECURELY TO PREVENT DISPLACEMENT AND DEFORMATION OF PANELS WHEN BACKFILLING.

2. INFILL FROM CREST OF THE SLOPE TO TOE TO PREVENT DISPLACEMENT. LIMIT DROP HEIGHT TO 3'.

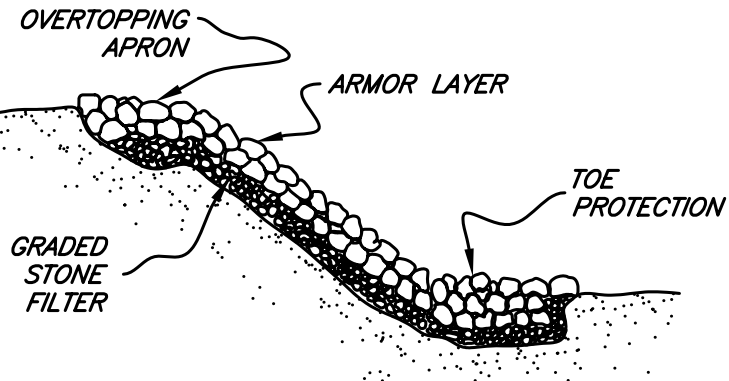


TYPICAL ROCK REVETMENT

DRAWING NOT TO SCALE

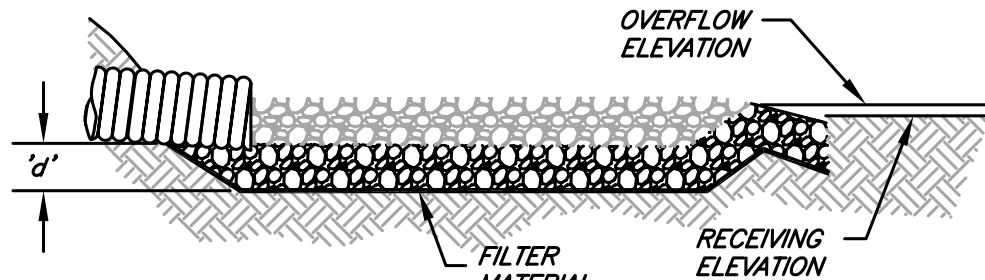

THICKNESS ('d') = 1.5 x MAX. ROCK DIAMETER - 6" (150mm) MIN.

SECTION

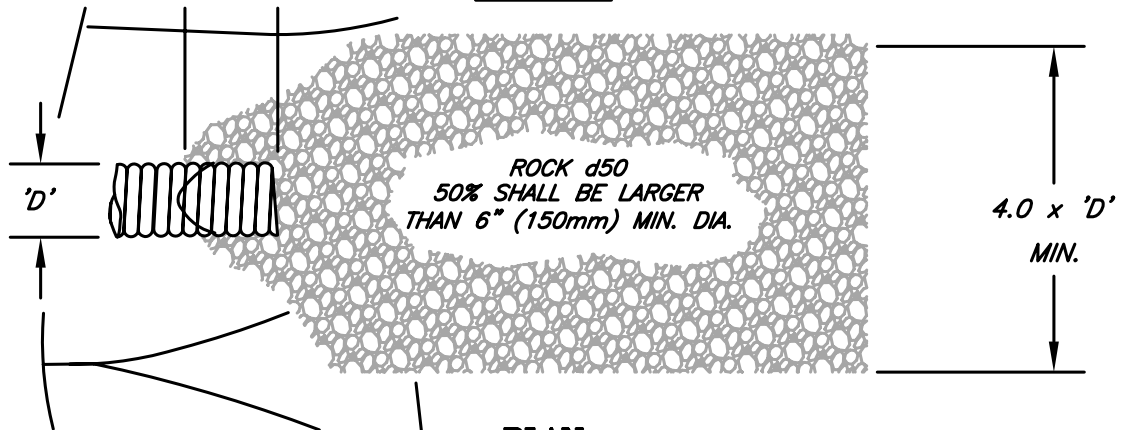

PLAN

ENERGY DISSIPATOR

NOTES:

1. 'La' = LENGTH OF APRON. DISTANCE 'La' SHALL BE OF SUFFICIENT LENGTH TO DISSIPATE ENERGY.
2. APRON SHALL BE SET AT A ZERO GRADE AND ALIGNED STRAIGHT.
3. FILTER MATERIAL SHALL BE FILTER FABRIC OR 6" (150mm) THICK MINIMUM GRADED GRAVEL LAYER.

EROSION CONTROL MANUAL

ARMORING

Detail Drawing 4.5-F