


P-258\_SANITARY\_SEWER\_TERMINAL\_CLEANOUT.DWG 12/14/16 3:06 PM RICKS

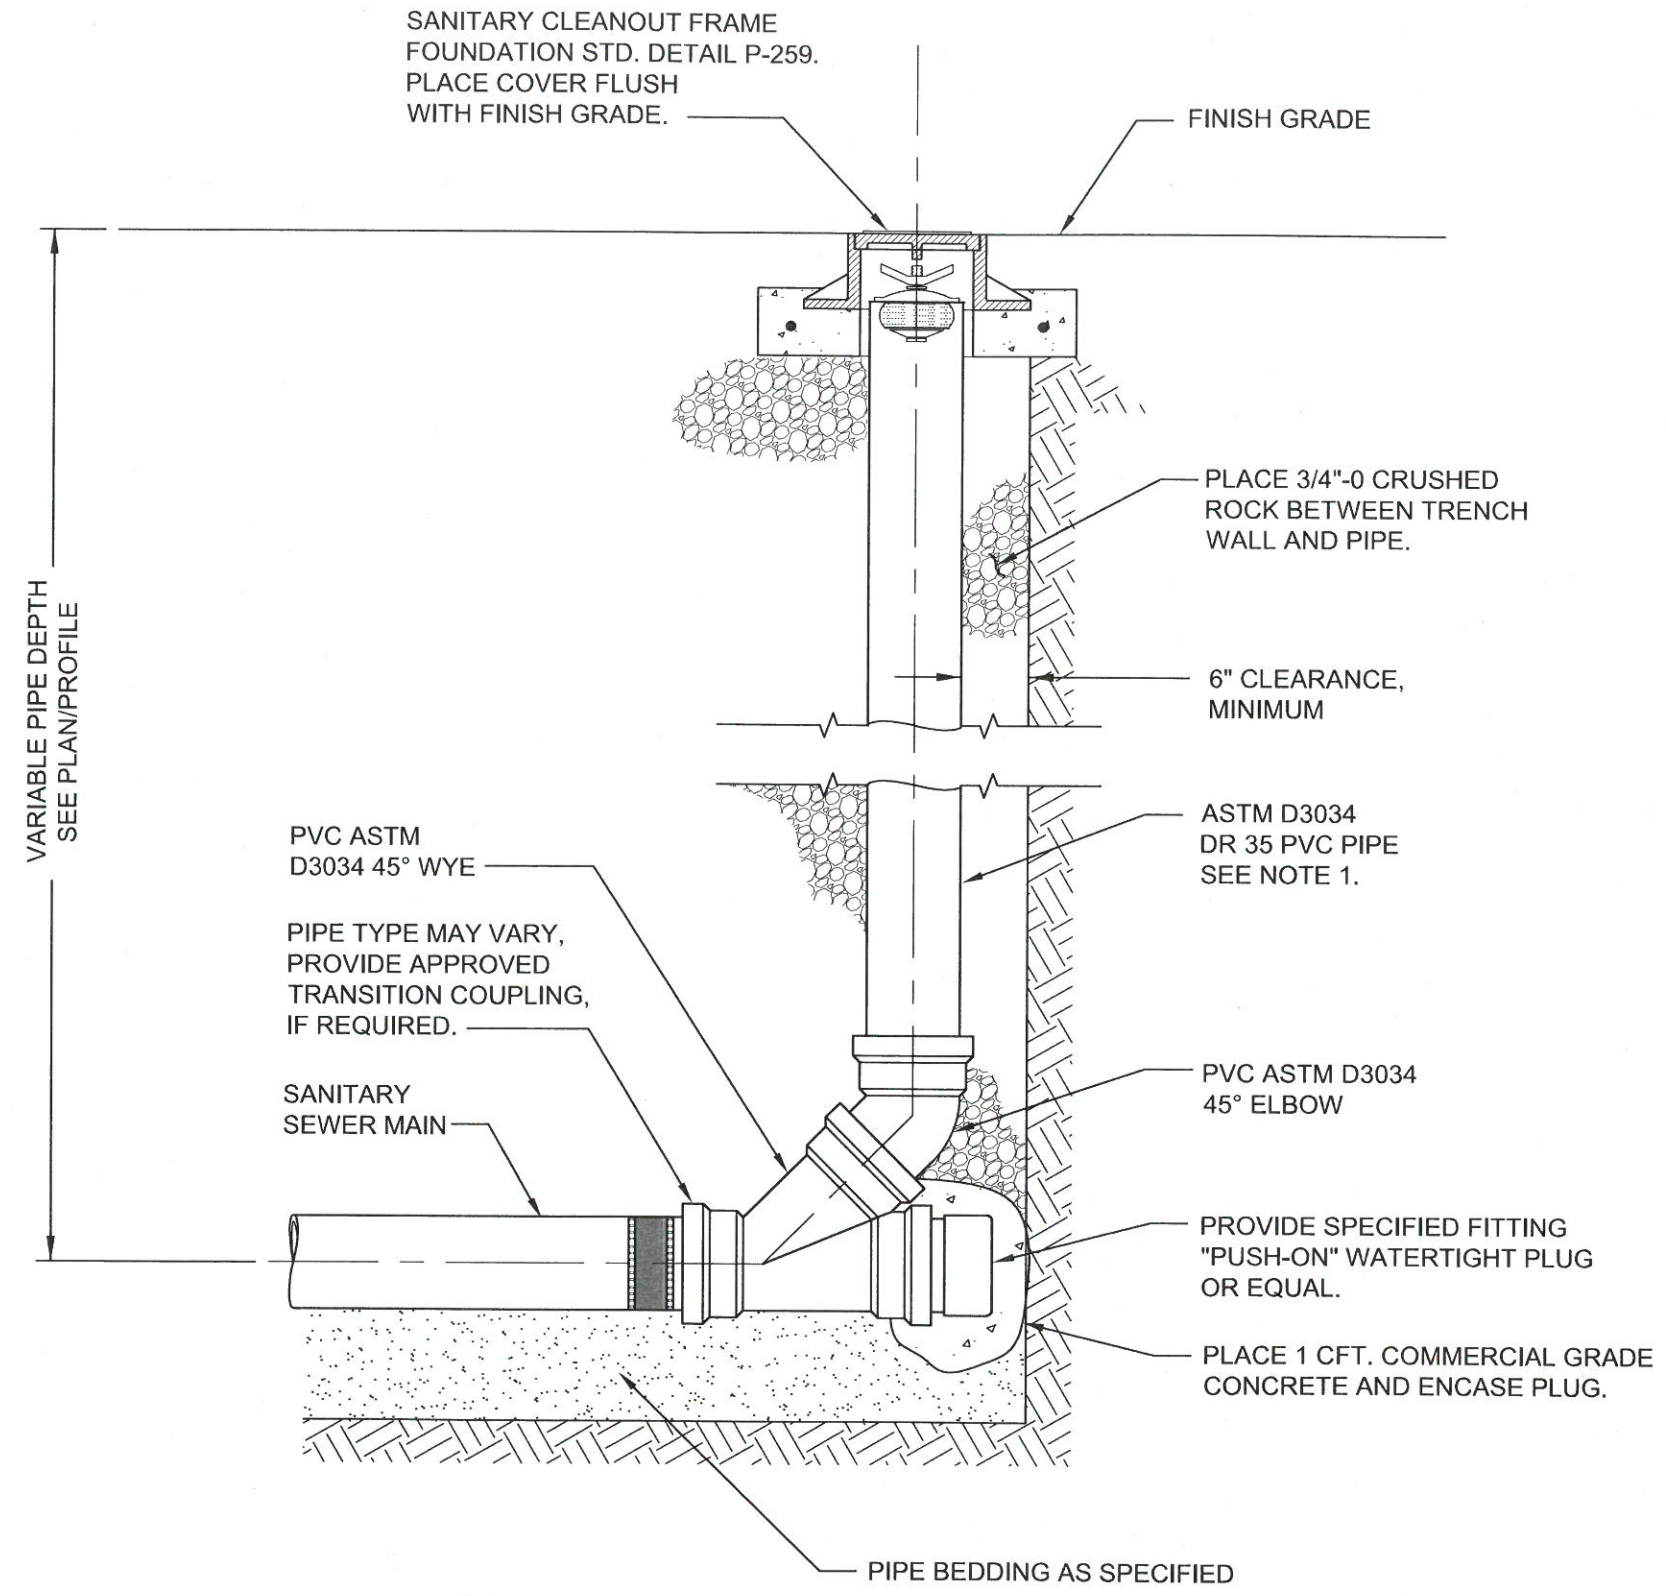

**NOTES:**

1. USE 6" DIA. CLEANOUT FOR 6" OR LARGER DIA. PIPE UNLESS OTHERWISE NOTED.
2. CLEANOUTS SHALL NOT BE LOCATED IN BIKE-PATHS OR IN CURBSIDE BUS OR TRUCK LOADING ZONES.

<p>The selection and use of this Standard Detail, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user.</p>	<p>Bureau of Environmental Services CITY OF PORTLAND, OREGON</p> <p><i>Walter Ryan</i> Chief Engineer</p>	
	<p>Standard Detail Title</p> <p><b>Sanitary Sewer Terminal Cleanout</b></p>	
<p>Note: All material and workmanship shall be in accordance with the City of Portland Standard Construction Specifications.</p>	<p>Effective Date: 06-22-12</p>	<p>Standard Detail No.</p> <p><b>P-258</b></p>
	<p>Calc. Book No.: N/A</p>	
	<p>Baseline Report Date: N/A</p>	