


SW Capitol Hwy 8" & 6" DI Mains

Note
Location of catch basin inlets shown are based on atlas and electronic files currently on record.

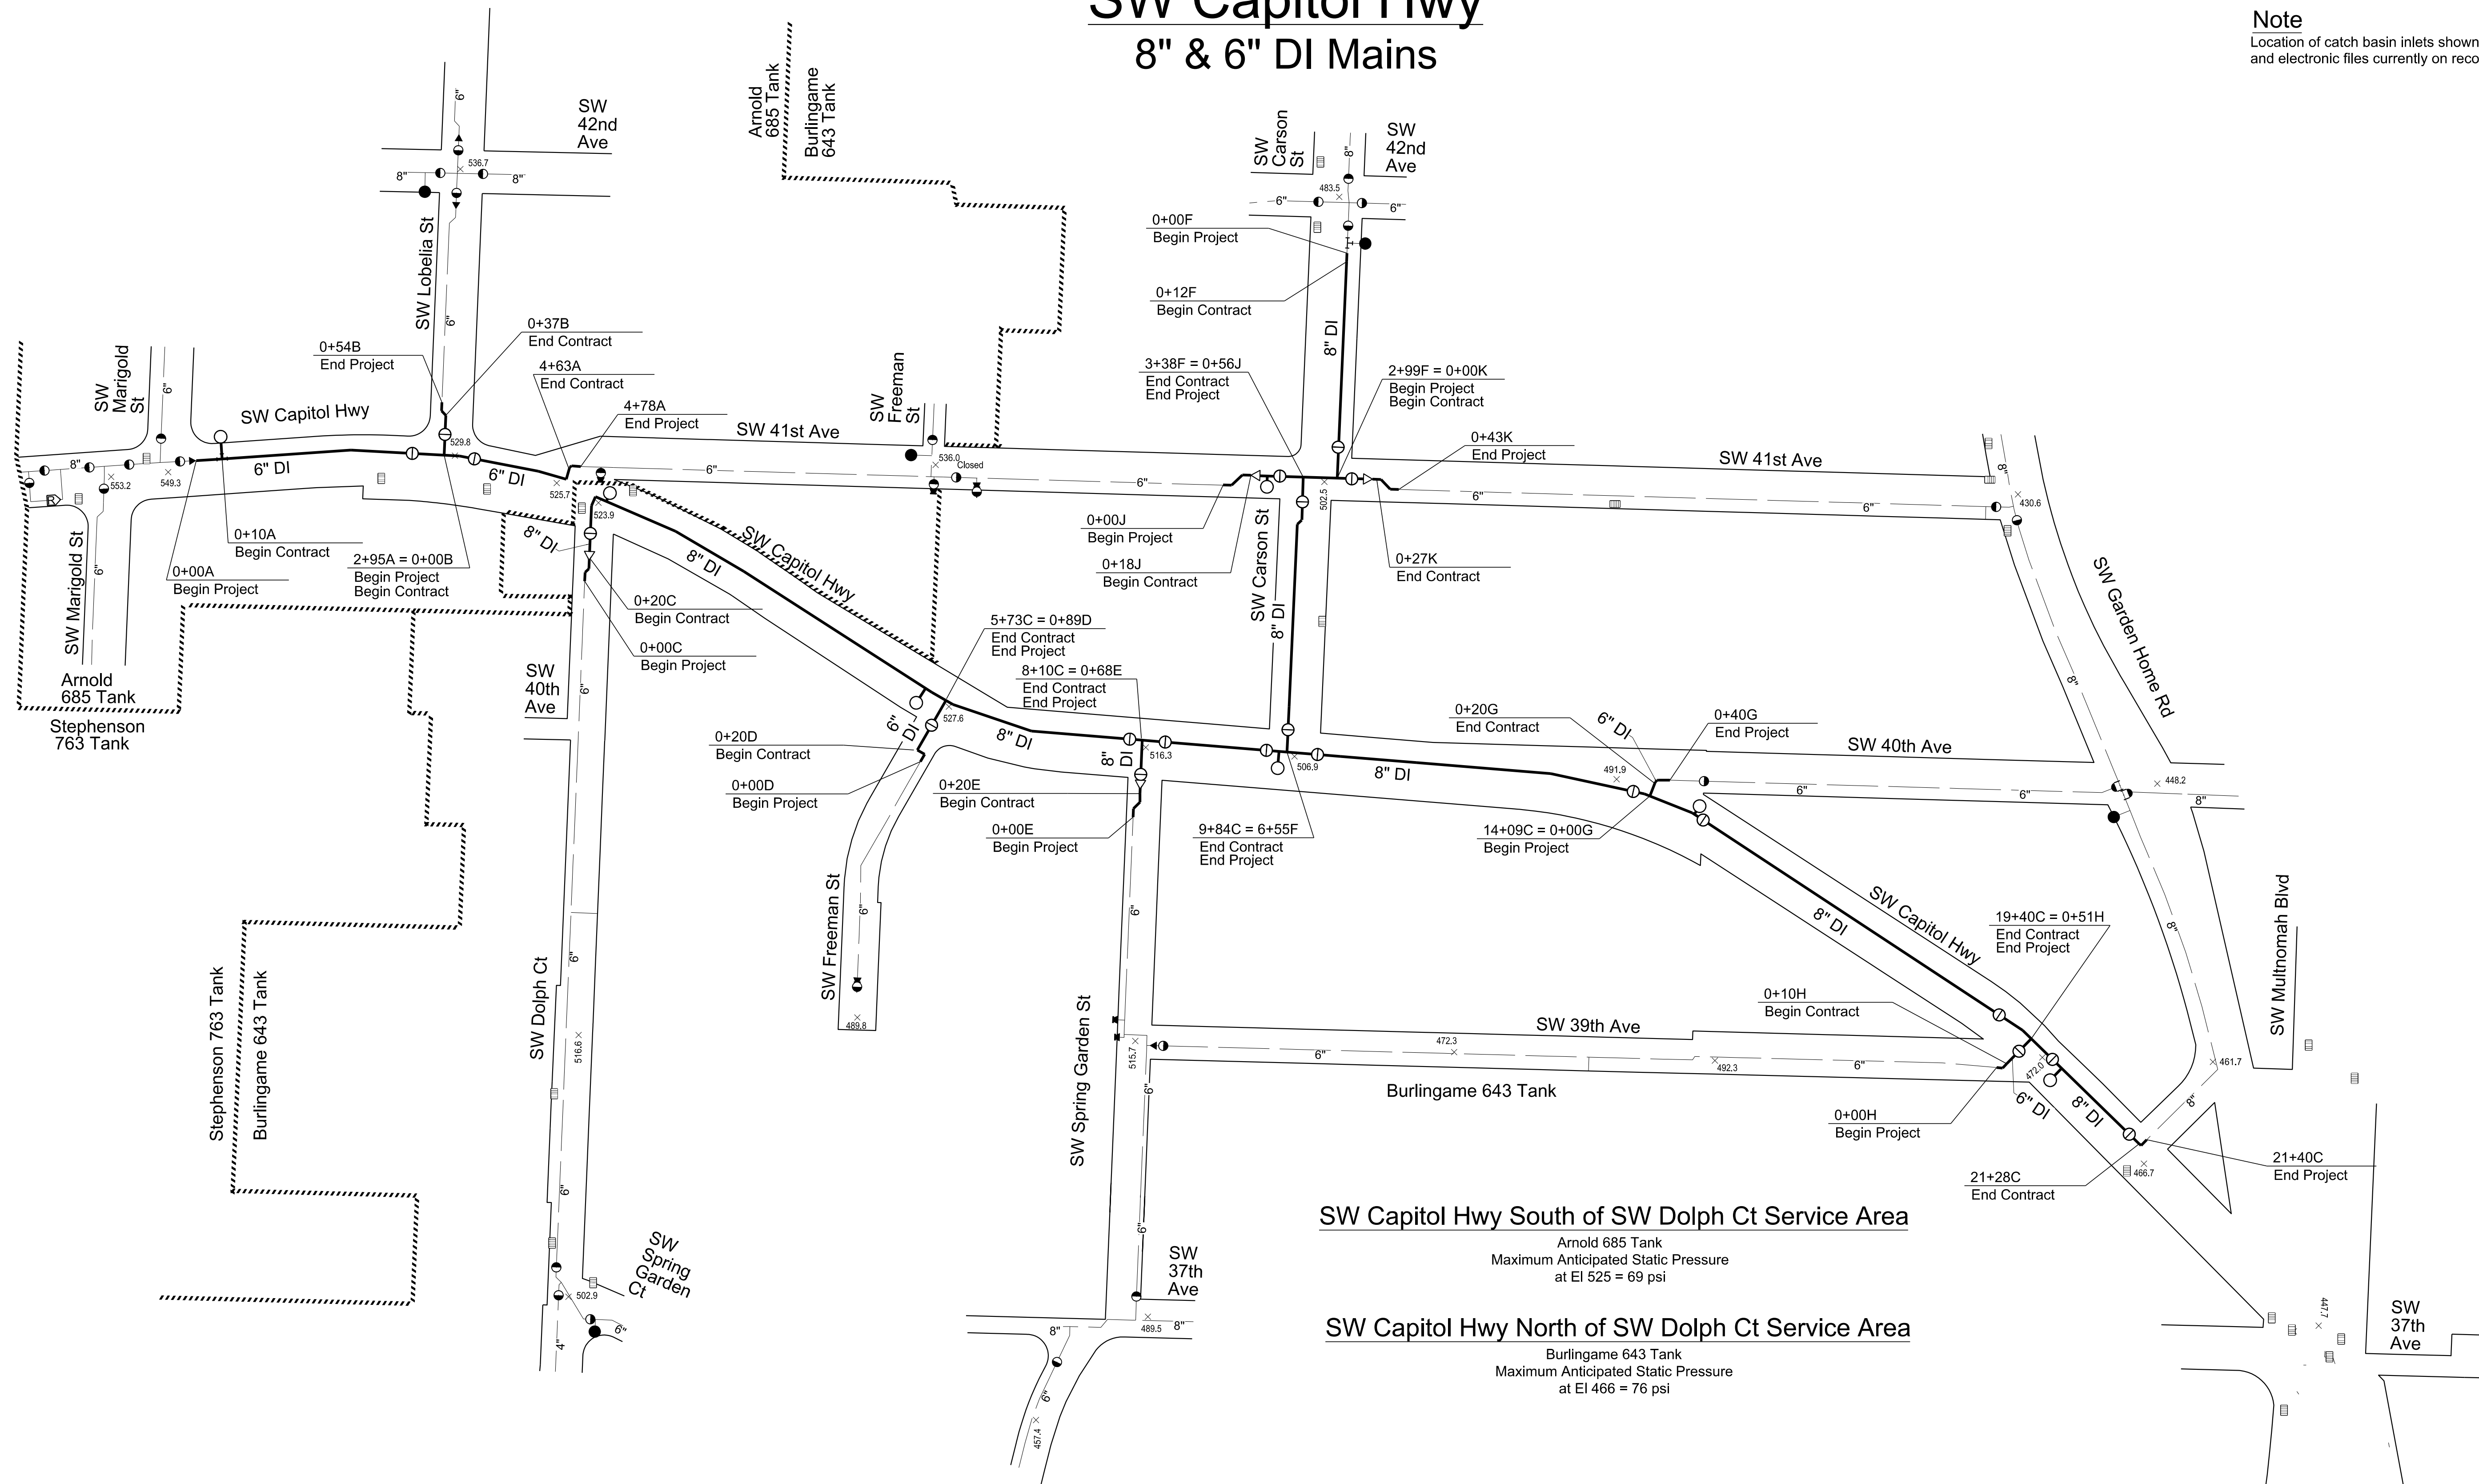


SW Capitol Hwy South of SW Dolph Ct Service Area

Arnold 685 Tank
Maximum Anticipated Static Pressure
at EI 525 = 69 psi

SW Capitol Hwy North of SW Dolph Ct Service Area

Burlingame 643 Tank
Maximum Anticipated Static Pressure
at EI 466 = 76 psi


Vicinity Map
NTS



11/6/2019 12:39:12 PM J:\Engineering\CAD\Projects\W02200 - W02299\W02292_SW_CapL_Hwy\W02292.dgn

No	Date	Description	Appd
Revision			
Survey	2018	By Others	

Designed By	CMC	Program Mgr	RAS
CAD Checked By	CMC	Const Mgr	XXX
Checked By	JLW	Const Supvr	MWL
Project Mgr	CMC	Date	

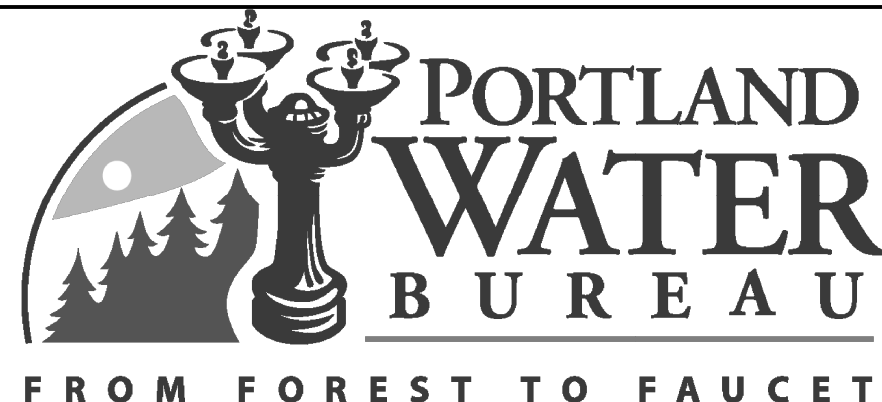

90% Plan Set

Teresa K. Ellis, Chief Engineer, PE No 61197 Date _____

Jodie A. Inman, Principal Engineer, PE No 61197 Date _____



8" & 6" DI Mains
SW Capitol Highway
From SW Marigold St
To SW Garden Home Rd

Title Sheet

SAP Project No
W02292
1/4 Section
3925 / 3825
Sheet No
W02
2 of 15