




Plot Date: 7/15/2010 7:27:13 AM Filename: I:\CADD\Standards\Drawings\11-P-DrawingBeingWorkedOn\P-825.dgn

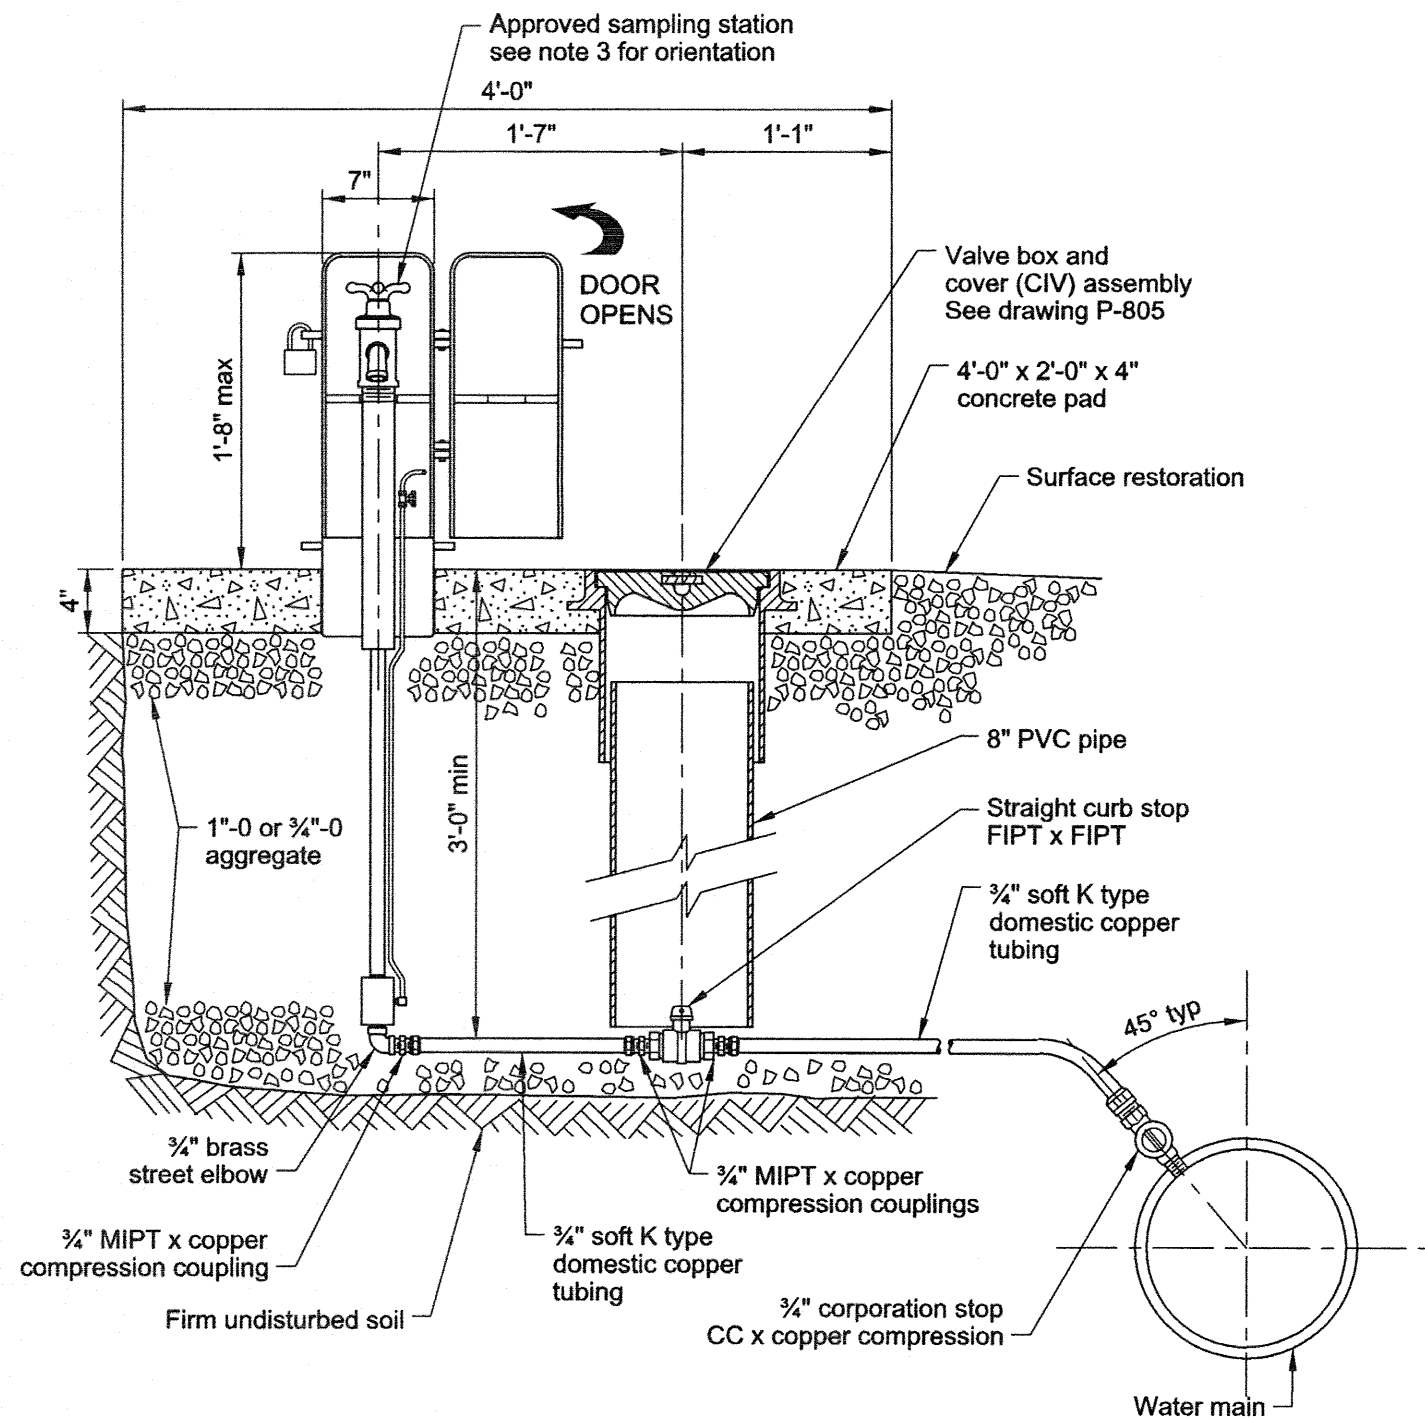

Notes:

1. Install concrete pad at all locations. Comply with all ADA requirements if installed in a sidewalk
2. All fill material shall be compacted and tested according to the City of Portland Standard Construction Specifications.
3. Sampling station door to face 90° from street such that hydrant nozzle is directed toward the nearest oncoming traffic.
4. Paint aluminum base contact surface with tar mastic prior to installing concrete.

The selection and use of this Standard Drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user.


PORTLAND WATER BUREAU
 CITY OF PORTLAND, OREGON

 Chief Engineer

Standard Drawing Title

SAMPLING STATION

Note:
All material and workmanship shall be in accordance with City of Portland Standard Construction Specifications.

| | | |
|----------------------|-------------|--|
| Effective Date | Jul 15 2010 | Standard Drawing No. P-825 |
| Calc. Book No. | PWB 1 | |
| Baseline Report Date | Jul 15 2010 | |